




THIS EDGE INTENTIONALLY LEFT BLANK FOR BINDING - PAPER SIZE 34" X 22" - THIS EDGE INTENTIONALLY LEFT BLANK FOR BINDING

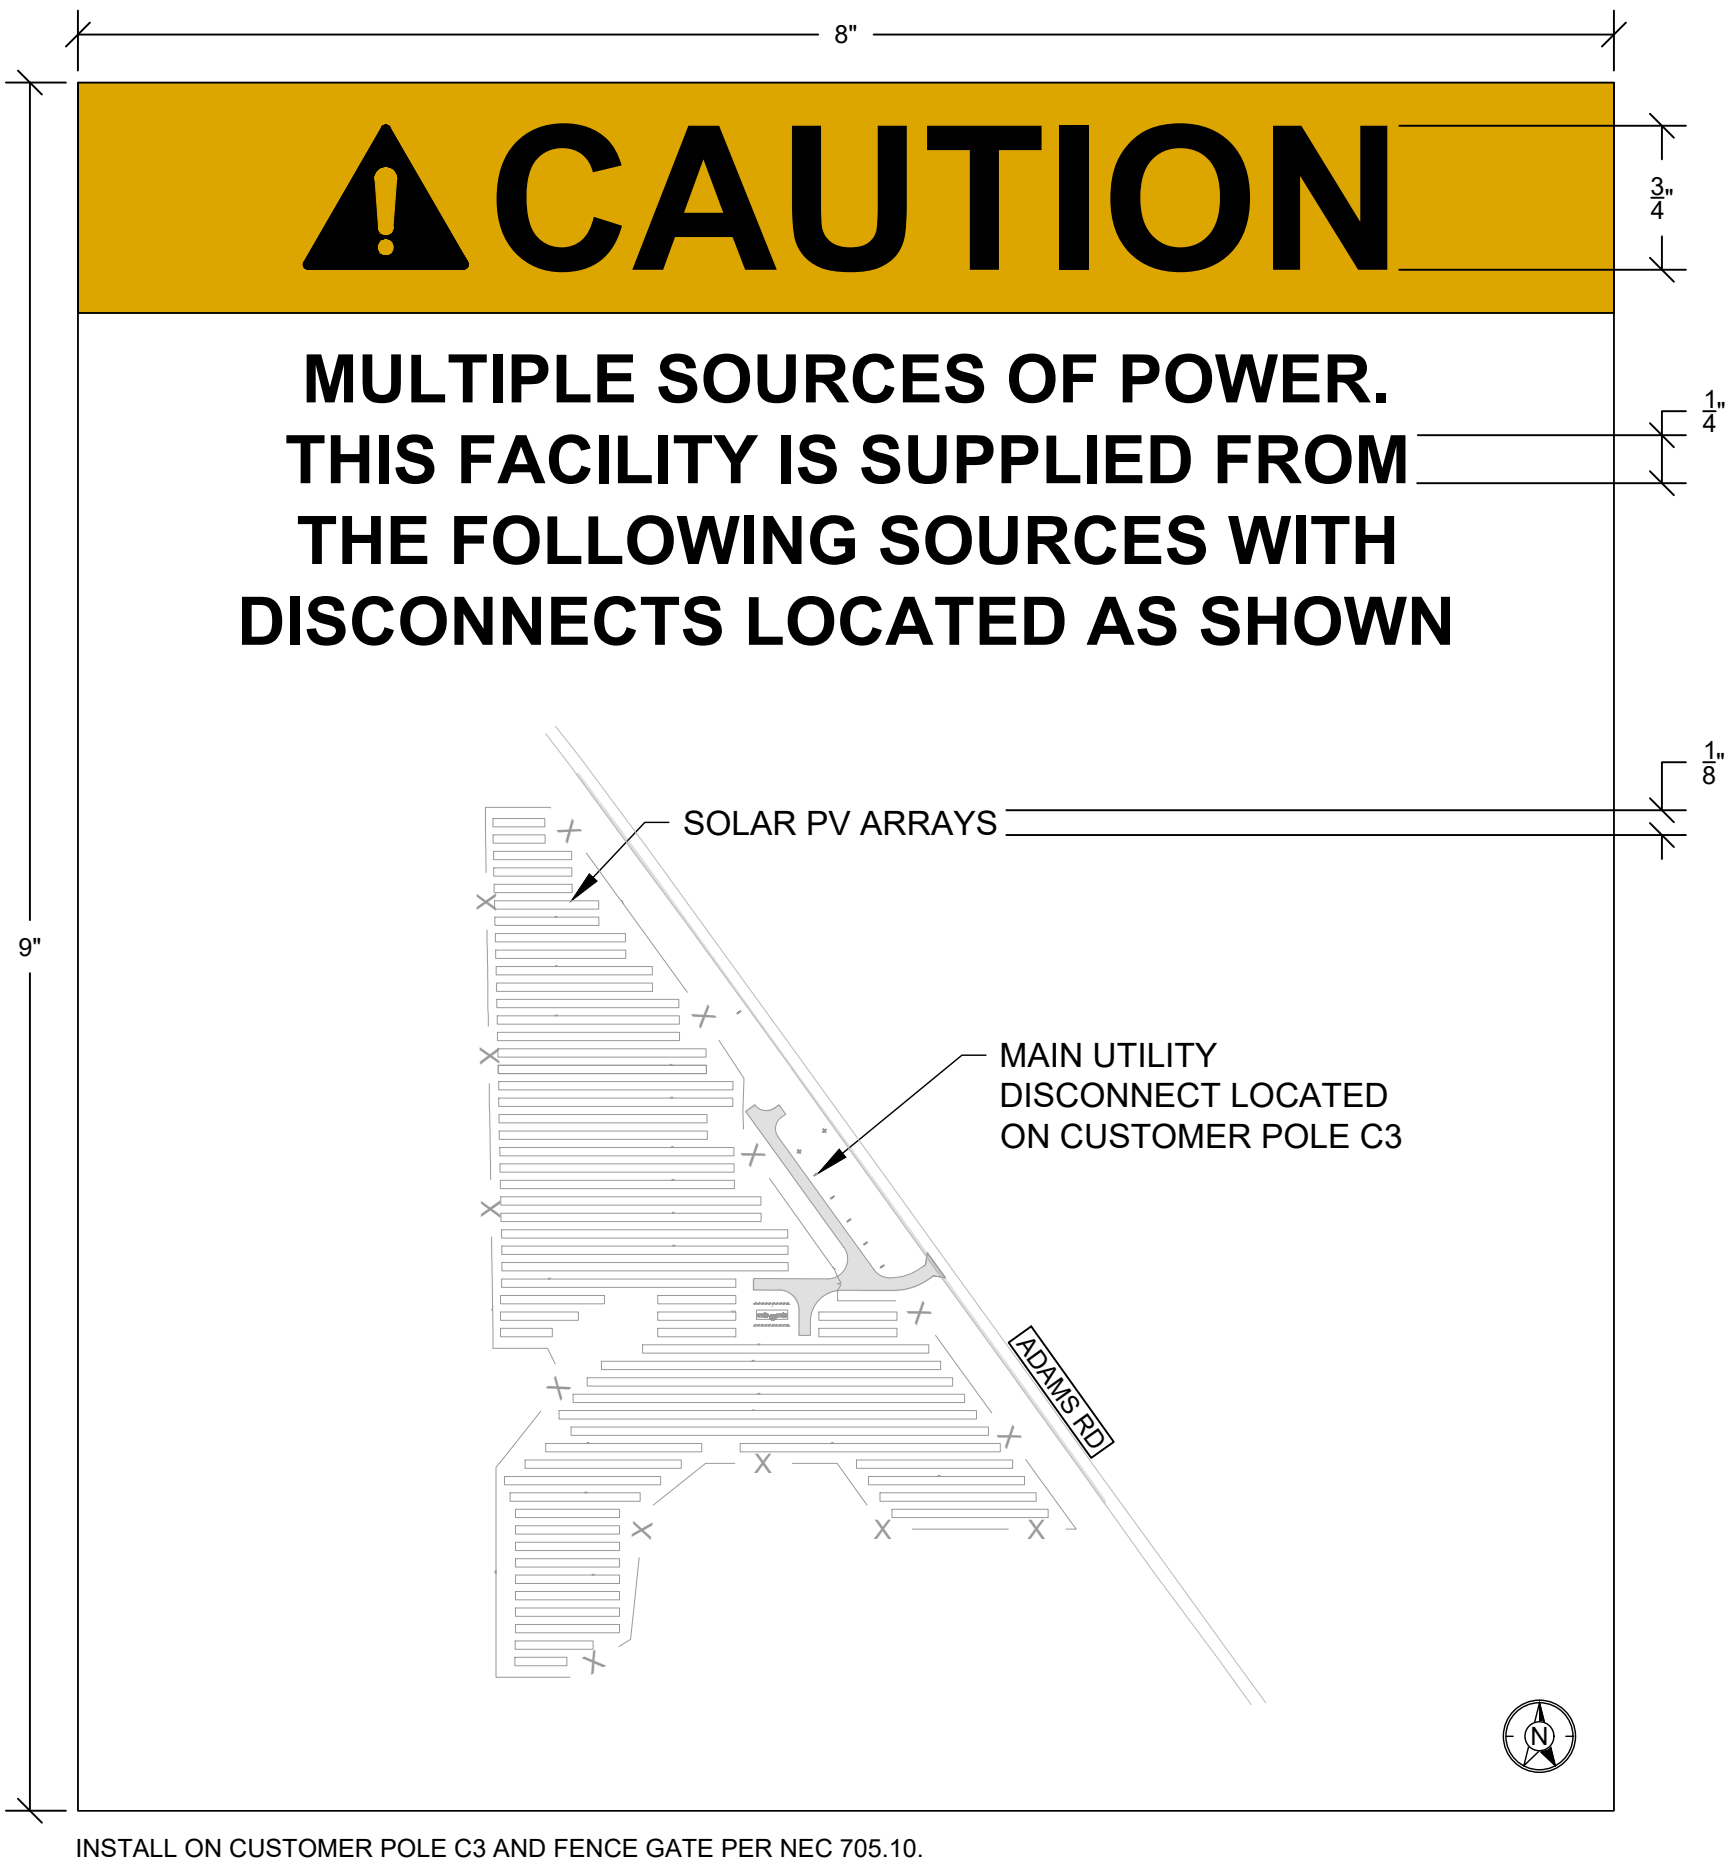

1 DIRECTORY
SCALE: NTS

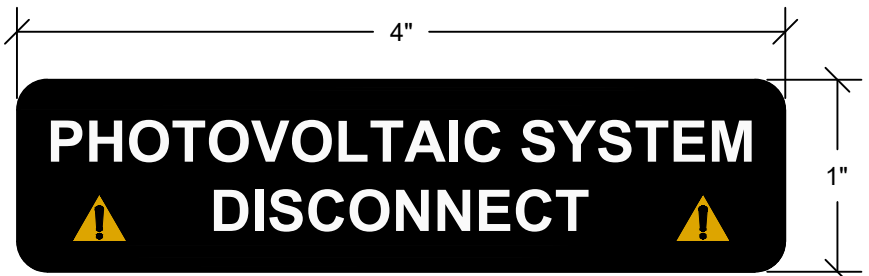


6 DISCONNECT SWITCH LABEL
SCALE: NTS

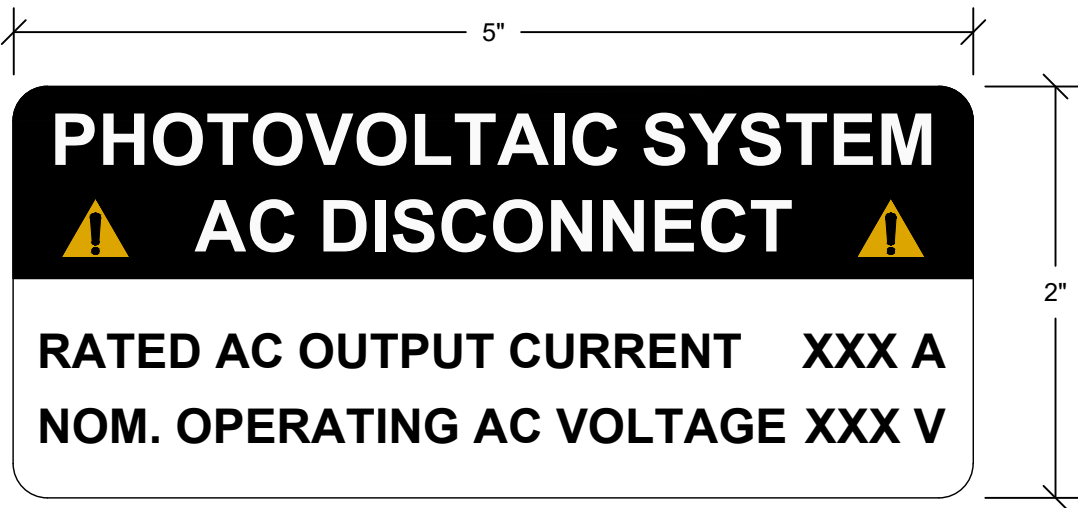


| SCHEDULE OF VALUES | | |
|--|---------|---------|
| EQUIPMENT | CURRENT | VOLTAGE |
| GOAB-1 | 630 A | 34.5 KV |
| XFMR-1 | 41.8 A | 34.5 KV |
| XFMR-2 | 41.8 A | 34.5 KV |
| SWBD-1 | 4000 A | 600 V |
| SWBD-2 | 4000 A | 600 V |
| INV-1.01 THRU INV-1.10, & INV-2.01 THRU INV-2.09 | 240.6 A | 600 V |
| INV-2.10 | 216.5 A | 600 V |


7 AC DISCONNECT LABELS
SCALE: NTS

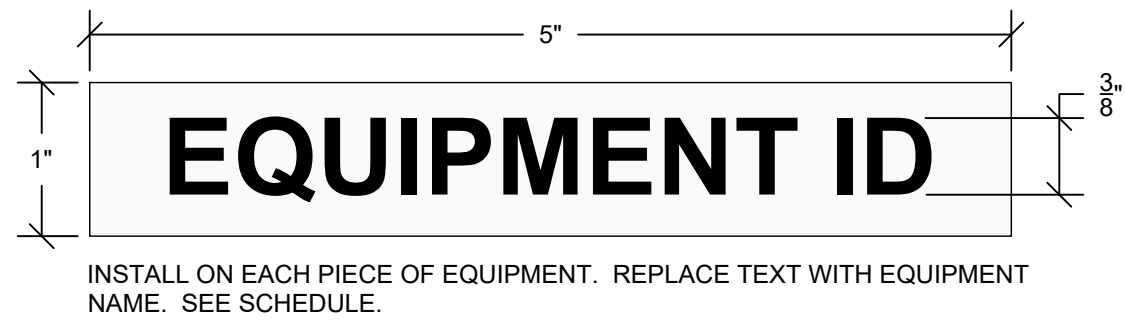


2 EQUIPMENT ID LABELS
SCALE: NTS

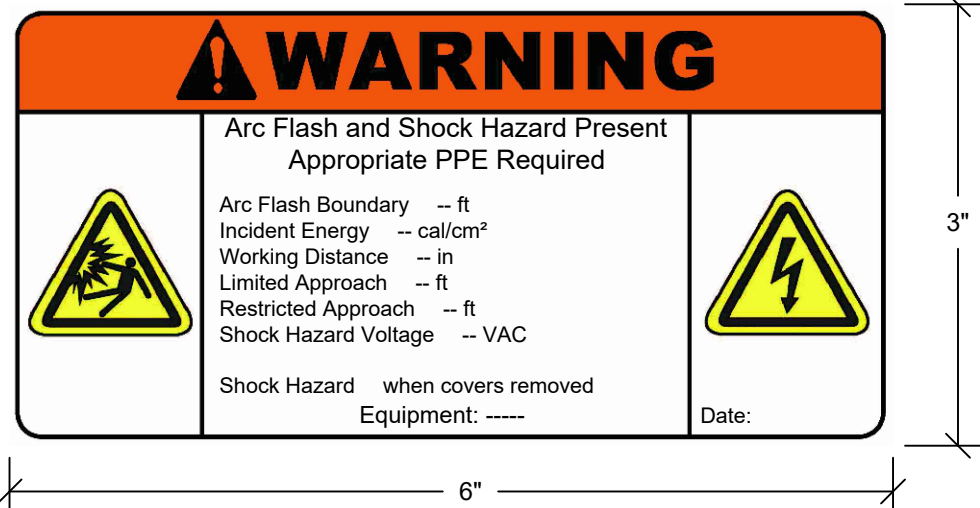


4 ARC FLASH LABELS
SCALE: NTS

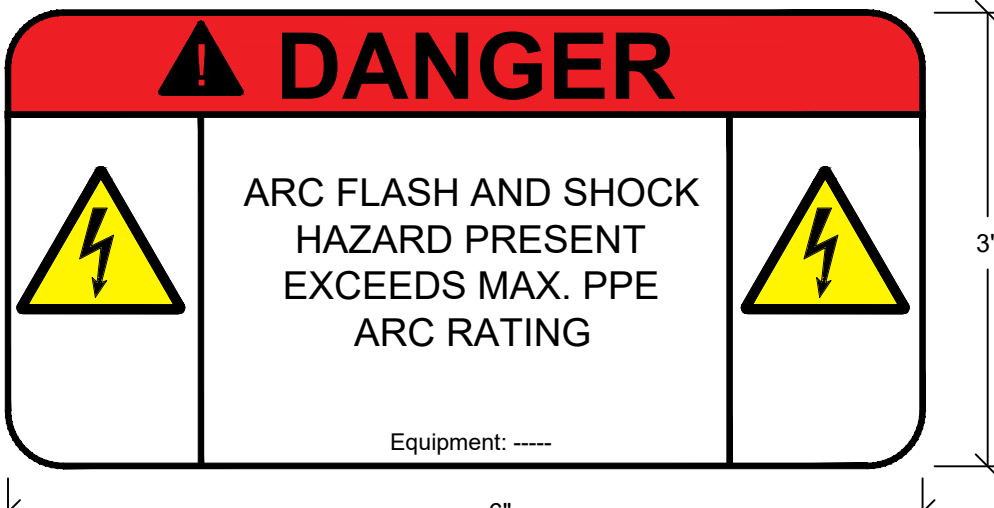


4 ARC FLASH LABELS
SCALE: NTS

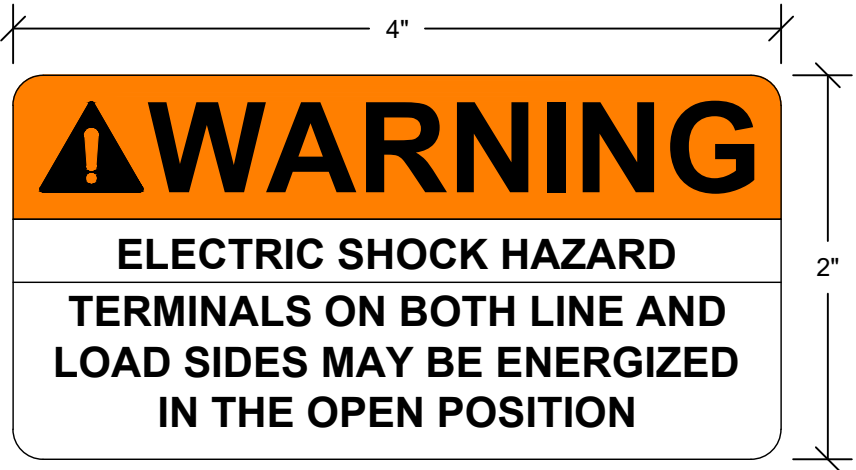

3 SHOCK HAZARD LABEL
SCALE: NTS

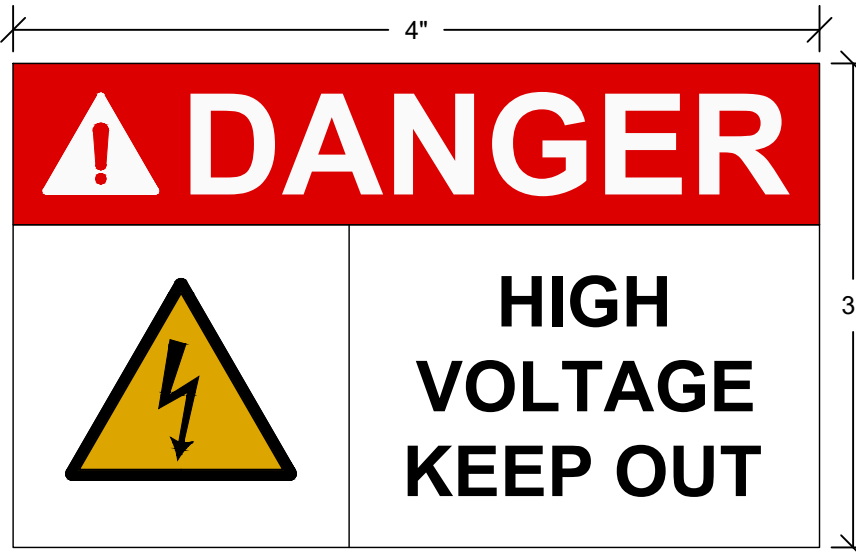


5 HIGH VOLTAGE LABEL
SCALE: NTS

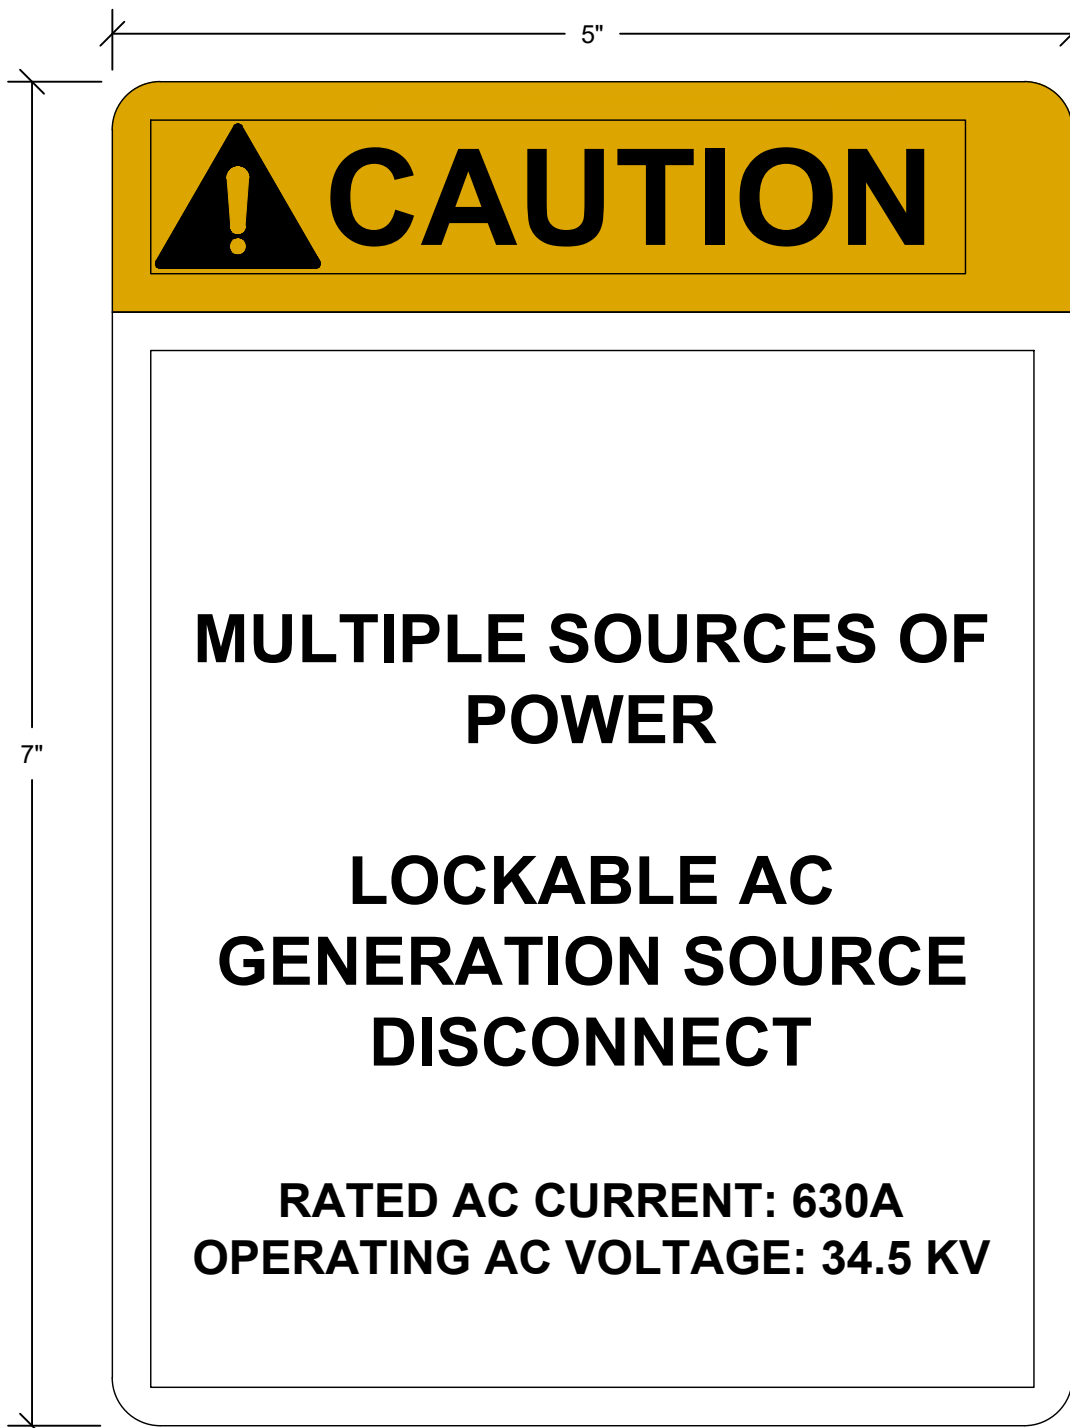

- 2-PLY OR 3-PLY, NON-CONDUCTIVE, PLASTIC ENGRAVED, UV RESISTANT, AND WEATHERPROOF PLATE TO BE SECURED WITH PERMANENT ADHESIVE
- INSTALL ON OR NEXT TO CUSTOMER DISCONNECT ON CUSTOMER DISCONNECT POLE (C3)
- IF PLAQUE CANNOT BE ATTACHED DIRECTLY TO OR NEXT TO DISCONNECT, DISCUSS ALTERNATIVE LOCATIONS WITH AMEREN ILLINOIS NET METERING COORDINATOR OR OTHER AMEREN ILLINOIS REPRESENTATIVE
- IF DISCONNECT IS WITHIN 10' OF SIGN AND WITHIN SIGHT OF UTILITY METER, ONLY 1 SIGN IS REQUIRED AT DISCONNECT. IF NOT, INSTALL LOCATION MUST BE APPROVED BY AMEREN REPRESENTATIVE AND A SECOND SIGN MUST BE INSTALLED. SEE DETAIL 10/E-701.

9 AC SAFETY DISCONNECT PLAQUE - METER IN SIGHT OF DISCONNECT
SCALE: NTS

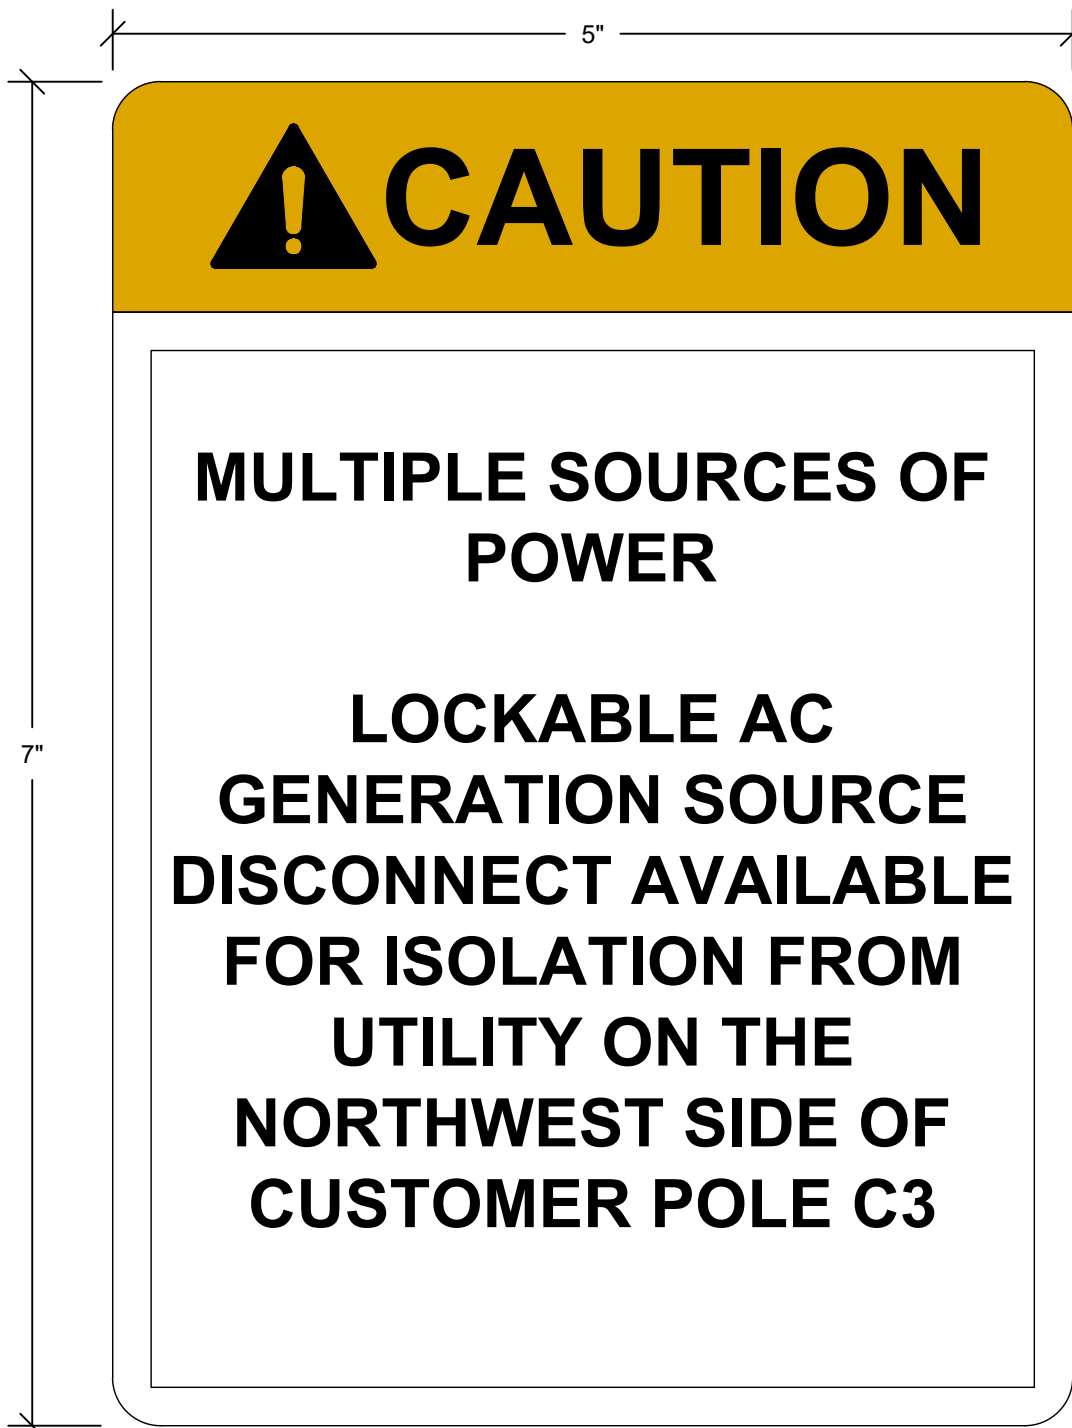

- 12-PLY OR 3-PLY, NON-CONDUCTIVE, PLASTIC ENGRAVED, UV RESISTANT, AND WEATHERPROOF PLATE TO BE SECURED WITH PERMANENT ADHESIVE
- INSTALL ON OR NEXT TO UTILITY METER ON UTILITY METER POLE (U1)

10 AC SAFETY DISCONNECT PLAQUE - UTILITY METER
SCALE: NTS

SHEET NOTES:

- LABELS SHALL BE INSTALLED IN ACCORDANCE WITH THE 2020 NEC.
- IN ADDITION TO NEC-REQUIRED LABELING, ALL MAJOR ELECTRICAL EQUIPMENT SHALL BE IDENTIFIED PER SPECIFICATIONS IN THIS PLAN SET. LABELS SHALL BE SUITABLE FOR THE ENVIRONMENT IN WHICH THEY ARE INSTALLED.
- INTERCONNECTION EQUIPMENT AND MATERIALS, INCLUDING SHARED EQUIPMENT WITH THE UTILITY, SHALL BE LABELED PER UTILITY SPECIFICATIONS.
- ALL LABELS TO COMPLY WITH ANSI STANDARDS FOR PROPER TEXT SIZE, DESIGN, ETC.
- ADDITIONAL LABELS MAY BE REQUIRED BY THE LOCAL AHJ AND/OR UTILITY. CONTRACTOR TO PROVIDE ALL REQUIRED LABELS.
- ALL ELECTRICAL EQUIPMENT TO BE SERVICED, INCLUDED BUT NOT LIMITED TO COMBINERS, INVERTERS, TRANSFORMERS, DISCONNECTS, PANELBOARDS, SWITCHBOARDS, AND SWITCHGEAR SHALL BE CLEARLY LABELED WITH WEATHERPROOF LABELS STATING ARC FLASH HAZARD INFORMATION IN ACCORDANCE WITH THE MOST CURRENT VERSION OF NFPA 70E.

DESIGN COORDINATOR



KNOBELSDORFF

25701 370TH STREET
GOODHUE, MN 55027

PROJECT

138883 CEMETERY SUN, LLC

24638 ADAMS RD.
FREDERICK, IL 62639
40.089020°, -90.442132°

ENGINEER



STELLAVISE SOLAR ENGINEERING

2535 CAMINO DEL RIO S, STE. 235
SAN DIEGO, CA 92108
IL DESIGN FIRM #184.009162

WWW.STELLAVISE.COM

(619) 837-5331

SEAL



THIS DRAWING AND ALL INFORMATION HEREIN IS THE PROPERTY OF STELLAVISE INC. ANY REPRODUCTION, MODIFICATION OR USE OF THIS DRAWING FOR OTHER THAN THE INTENDED PROJECT WITHOUT PRIOR WRITTEN AUTHORIZATION FROM STELLAVISE INC. IS STRICTLY FORBIDDEN.

REVISIONS

| # | DESCRIPTION | DATE |
|---|-------------|------------|
| 0 | IFC | 02/06/2026 |
| 1 | IFC R1 | 02/27/2026 |

ISSUED FOR CONSTRUCTION
FEBRUARY 27, 2026

138883 CEMETERY
SUN, LLC
FREDERICK, IL, 62639

SHEET TITLE

EQUIPMENT SIGNAGE

SHEET NO.

E-701